



For Hydro Ottawa Use Only Copyright 2017

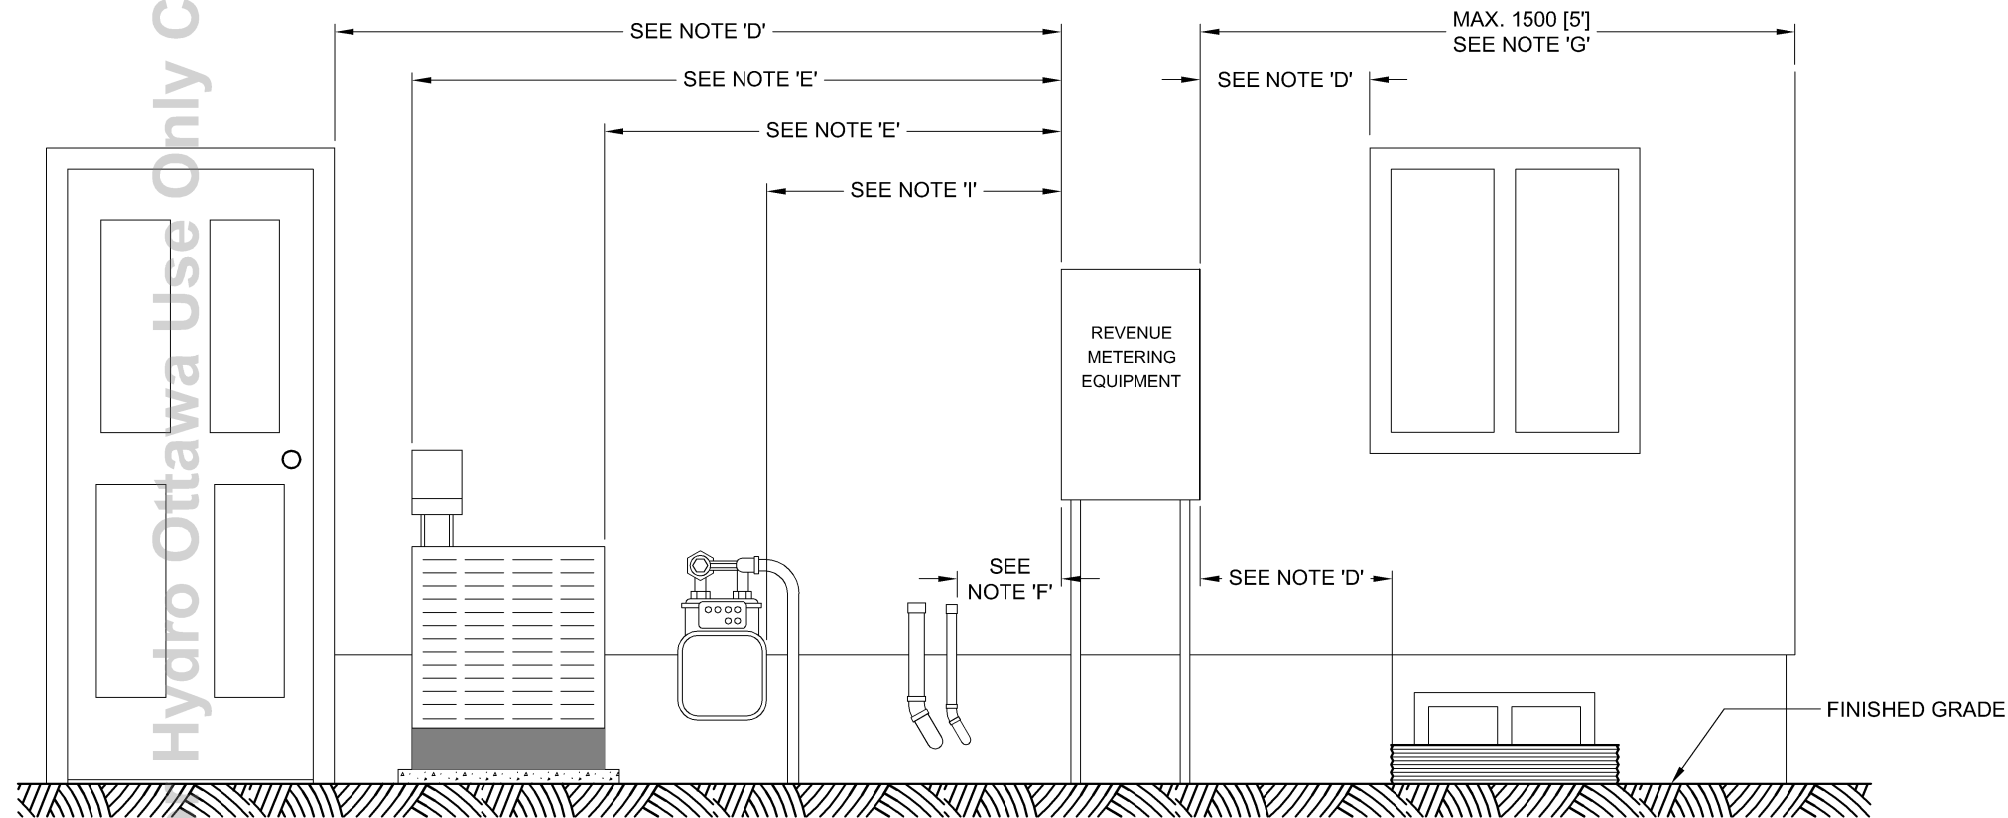

NOTES:

- A. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE SPECIFIED.
- B. THE INTENT OF THE CLEARANCES SPECIFIED IS TO PROVIDE SUFFICIENT SPACE FOR THE USE OF HYDRO OTTAWA PERSONNEL ACCESSING THE REVENUE METERING EQUIPMENT.
- C. REFER TO HYDRO OTTAWA SPECIFICATIONS GCS0008, MCS0099, MCS0105, MCS0107, AND MCS0108 MORE INFORMATION ON REQUIRED CLEARANCES BETWEEN REVENUE METERING AND GAS RELATED EQUIPMENT.
- D. MINIMUM OF 500 [1' 8"] OF HORIZONTAL CLEARANCE BETWEEN REVENUE METERING EQUIPMENT AND DOORS, WINDOWS, AND WINDOW-WELLS REQUIRED.
- E. MINIMUM OF 500 [1' 8"] OF HORIZONTAL CLEARANCE BETWEEN REVENUE METERING EQUIPMENT AND HVAC EQUIPMENT, AND THEIR DISCONNECTS REQUIRED.
- F. MINIMUM OF 1000 [3' 4"] OF HORIZONTAL CLEARANCE BETWEEN REVENUE METERING EQUIPMENT AND EXTERNAL VENTS (INCLUDING FILL SPOUTS FOR FURNACE OIL TANKS AND LOW TEMPERATURE EXHAUSTS FOR GAS FIRED HOT WATER HEATERS AND FURNACES), STACKS, AND CONNECTIONS FOR FIRE FIGHTING EQUIPMENT REQUIRED.
- G. REVENUE METERING TO BE LOCATED WITHIN 1500 [5'] FROM THE CORNER CLOSEST TO THE POINT OF SUPPLY.
- H. REFER TO HYDRO OTTAWA SPECIFICATIONS GCS0008 MCS0113 FOR MORE INFORMATION.
- I. MINIMUM HORIZONTAL CLEARANCE OF:
 - i. 1000 [3' 4"] BETWEEN REVENUE METERING EQUIPMENT AND NATURAL GAS RELATED EQUIPMENT REQUIRED.
 - ii. 3000 [10'] BETWEEN REVENUE METERING EQUIPMENT AND PROPANE RELATED EQUIPMENT REQUIRED.

2017-10-05 12:56 PM

REVISIONS			PREP	CHKD	APPD	 www.hydroottawa.com	TITLE ENGINEERING SPECIFICATION AGR/COM/ERF/RES MINIMUM OUTDOOR CLEARANCES NEXT TO REVENUE METERING EQUIPMENT CONSTRUCTION DETAIL
REV:	DATE:	CHANGE:	GM	RW	CSM		
REV: 1	DATE: 2017-01-17	CHANGE: REDUCE CLEARANCES				PREP: G. MOLNAR	NO: MCS0106
REV:	DATE:	CHANGE:				CHKD: S. McNALLY P.Eng	
REV:	DATE:	CHANGE:				APPD: C. MALONE P.Eng	
REV:	DATE:	CHANGE:				DATE: 2016-03-24 SCALE: N.T.S. @ ANSI B	
							1 OF 1 REV: 1